

**SECTION 00808**

**CERTIFICATE OF SUBSTANTIAL COMPLETION**

DATE OF ISSUANCE 2/23/2016

OWNER St. Charles Parish Government  
CONTRACTOR Tasch Electric, LLC  
Contract: 10/13/2015  
Project: St. Charles Parish EOC Grounding

OWNER's Contract No. P150701 ENGINEER's Project No. 1501101

This Certificate of Substantial Completion applies to all Work under the Contract Documents or to the following specified parts thereof:

To St. Charles Parish Government  
OWNER

And To Tasch Electric, LLC  
CONTRACTOR

The Work to which this Certificate applies has been inspected by authorized representatives of OWNER, CONTRACTOR and ENGINEER, and that Work is hereby declared to be substantially complete in accordance with the Contract Documents on

2/18/2016  
DATE OF SUBSTANTIAL COMPLETION

A tentative list of items to be completed or corrected is attached hereto. This list may not be all-inclusive, and the failure to include an item in it does not alter the responsibility of CONTRACTOR to complete all the Work in accordance with the Contract Documents. The items in the tentative list shall be completed or corrected by CONTRACTOR within 30 days of the above date of Substantial Completion.

The responsibilities between OWNER and CONTRACTOR for security, operation, safety, maintenance, heat, utilities, insurance and warranties and guarantees shall be as follows:

OWNER: Jason Tastet, St. Charles Parish Government

Larry Cochran, Parish President

CONTRACTOR: Grant Lovetro, Tasch Electric, LLC

The following documents are attached to and made a part of this Certificate: Punch list dated 2/22/2016

*[For items to be attached see definition of Substantial Completion as supplemented and other specifically noted conditions precedent to achieving Substantial Completion as required by Contract Documents.]*

This certificate does not constitute an acceptance of Work not in accordance with the Contract Documents nor is it a release of CONTRACTOR's obligation to complete the Work in accordance with the Contract Documents. **Submit 6 (six) original documents signed and dated by the Engineer and Contractor to Department of Homeland Security and Emergency Preparedness, 15026 River Road, Hahnville, La 70057 for processing.**

Executed by ENGINEER on 2/23/2016  
Date

Jason Chauvin

ENGINEER

By:

(Authorized Signature)

CONTRACTOR accepts this Certificate of Substantial Completion on

3-8-16

Date

Tasch Electric, LLC

CONTRACTOR

By:

(Authorized Signature)

OWNER accepts this Certificate of Substantial Completion on 3/16/2016

Date

St Charles Parish Government

OWNER

By:

(Authorized Signature)

Parish President



**HUSEMAN**  
& Associates  
Consulting Engineers

## FIELD REPORT # 5 - PUNCH LIST

**DATE:** February 22, 2016  
**TO:** Tasch Electric, LLC  
**ATTN:** Grant Lovetro  
**FROM:** Jason Chauvin  
**VIA:** E-Mail

**CC:** Jason Tastet  
**Project #:** 1501101  
**Project Name:** St. Charles Parish  
EOC Grounding  
**Client Project #:** P150701

---

**Observation Date:** Monday, February 22, 2016      **Time:** 10:00 AM  
**Weather:** Overcast      **Temperature:** 70°F  
**Participants:** Jason Chauvin, Jason Tastet, David (Tasch)


---

On this date, the following observations for the above referenced project were revealed:

1. Provide O&Ms & as built.
2. Maintain swale to previous grade between generator building and paint shop.
3. Install sod in all affected areas. (\$2,500)
4. Repair irrigation lines in affected areas. (\$1,000)
5. Replace landscaping in affected areas. (\$2,500)
6. Repair holes drilled in floor of generator building beneath bus bar. (\$500)
7. Install grounding jumper to steel framing supporting transformers. (\$400)
8. UPS (\$400)
  - a. The large ground shall be disconnected, coiled up and put up into accessible ceiling for future use.
  - b. The small ground that is routed into the UPS shall be disconnected and reconnected to the metal enclosure of the UPS (where the large ground is currently connected).
  - c. Remove nuts from top of enclosure and turn over the manuals on top of the gear to Owner.
9. Generator Room Ground Bar (SSGB #2): Provide labels for conductors. (\$200)
10. See photos below:

Punch Total: \$7,500



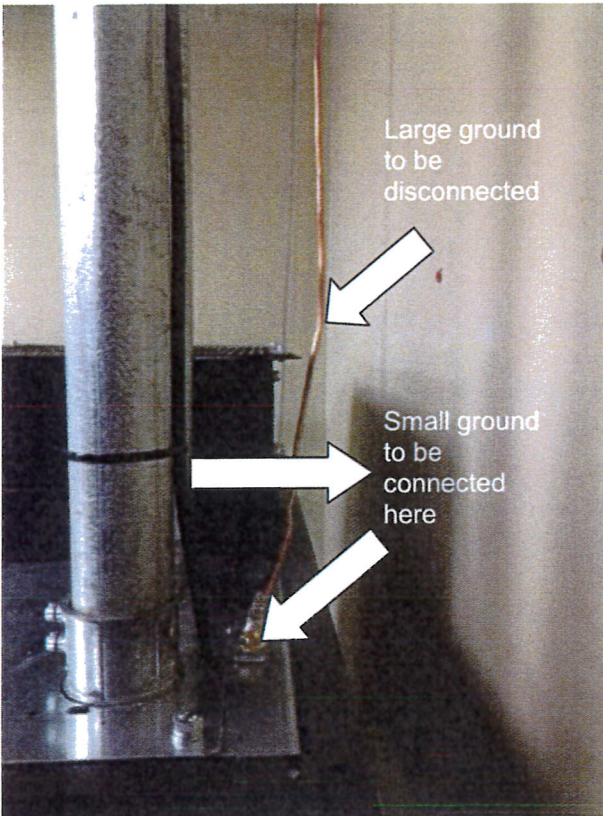

Disconnect and reconnect grounds



Landscaping and irrigation to be repaired (typical)



Landscaping and irrigation to be repaired (typical)




Sodding required (typical)





Sodding required and swale to be maintained

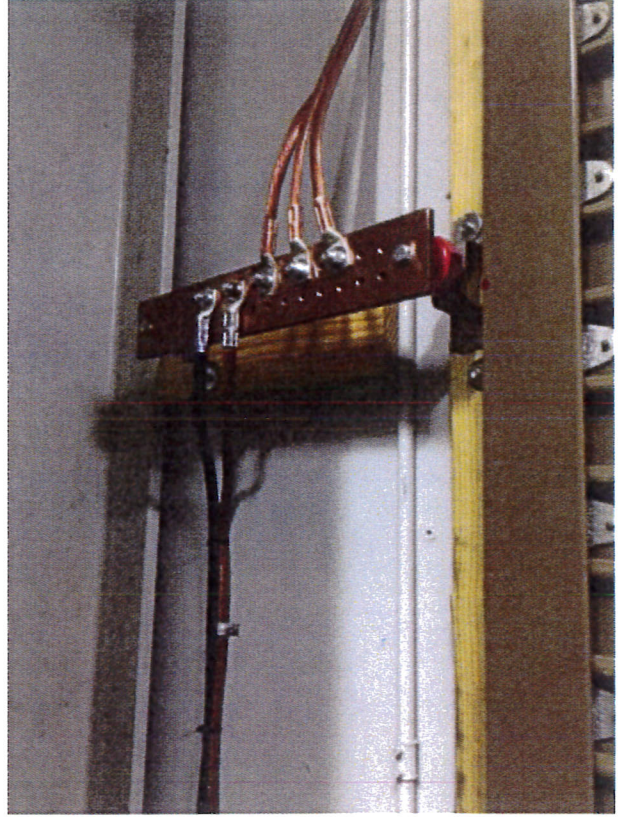

Labels required